

IMPORTANT SAFETY AND INSTALLATION INSTRUCTIONS

WARNING: Risk of fire and electrical shock. This product is to be installed by a qualified electrician only.

CAUTION: When using electrical equipment, basic safety precautions should always be followed including the following: Read all instructions carefully before installation and save

for future use. Make sure installation and all connections are in accordance with National Electrical Code and any local regulations. To avoid possible electrical shock, be sure that power supply is turned off before installing or servicing this fixture. Servicing should be performed by qualified service personnel.


These instructions do not claim to cover all details or variations. When additional information is desired, please contact your SPI representative.

Lightruss Rail - Rail System Mounting

Rail System Mounting Requirements:

1. Each rail section requires at least one mounting assembly (Cable or Stem).
2. Mounting span within the system can not exceed 8 feet maximum.
3. Corner tubes require one mounting assembly just outside of each end.
4. A mounting assembly is required within 14" of each rail splice.
5. No more than 4 feet of fixtures can be mounted within an 8 foot span.

Examples: (Four) 1 foot fixtures
(Two) 1 foot and (One) 2 foot fixtures
(Two) 2 foot fixtures

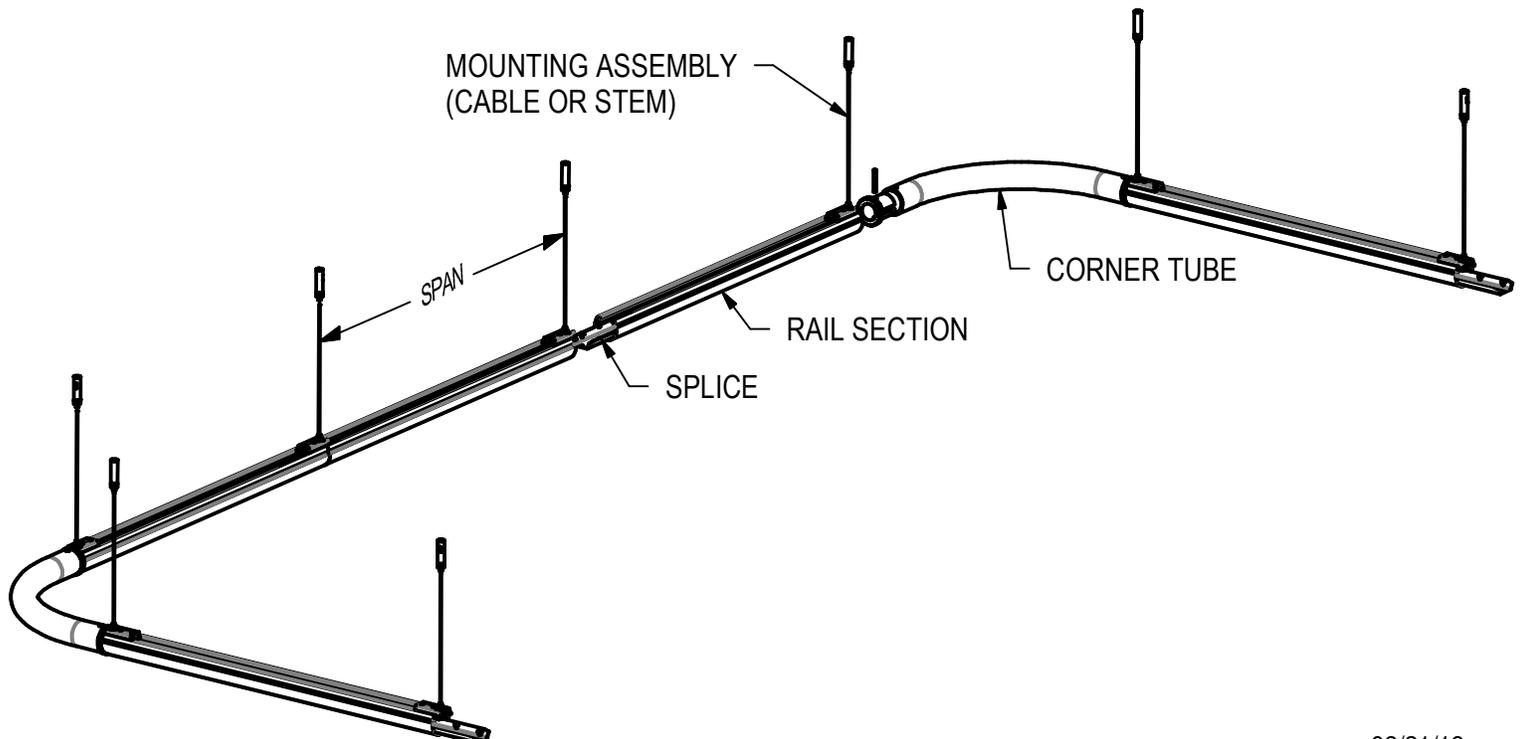

08/21/19
IS101001X