

IMPORTANT SAFETY AND INSTALLATION INSTRUCTIONS

WARNING: Risk of fire and electrical shock. This product is to be installed by a qualified electrician only.


CAUTION: When using electrical equipment, basic safety precautions should always be followed including the following: Read all instructions carefully before installation and save

for future use. Make sure installation and all connections are in accordance with National Electrical Code and any local regulations. To avoid possible electrical shock, be sure that power supply is turned off before installing or servicing this fixture. Servicing should be performed by qualified service personnel.

These instructions do not claim to cover all details or variations. When additional information is desired, please contact your SPI representative.

MADRID CEILING MOUNT WITH 3/4" HOLE FOR CONDUIT

1. REMOVE BOTTOM LENS & INNER DIFFUSER LENS (4) 8-32 KEPS NUTS
2. LOOSEN (4) KNURLED BATTERY NUTS FROM INSIDE FIXTURE TO DETACH 2" SPACER BOX
3. FASTEN 2" SPACER BOX TO JUNCTION BOX (HARDWARE BY OTHERS).
4. MAKE ELECTRICAL CONNECTIONS.
5. FASTEN FIXTURE BACK TO MOUNTED 2" SPACER BOX USING (4) KNURLED BATTERY NUTS.
6. REPLACE INNER DIFFUSER LENS (4) 8-32 KEPS NUTS & BOTTOM LENS

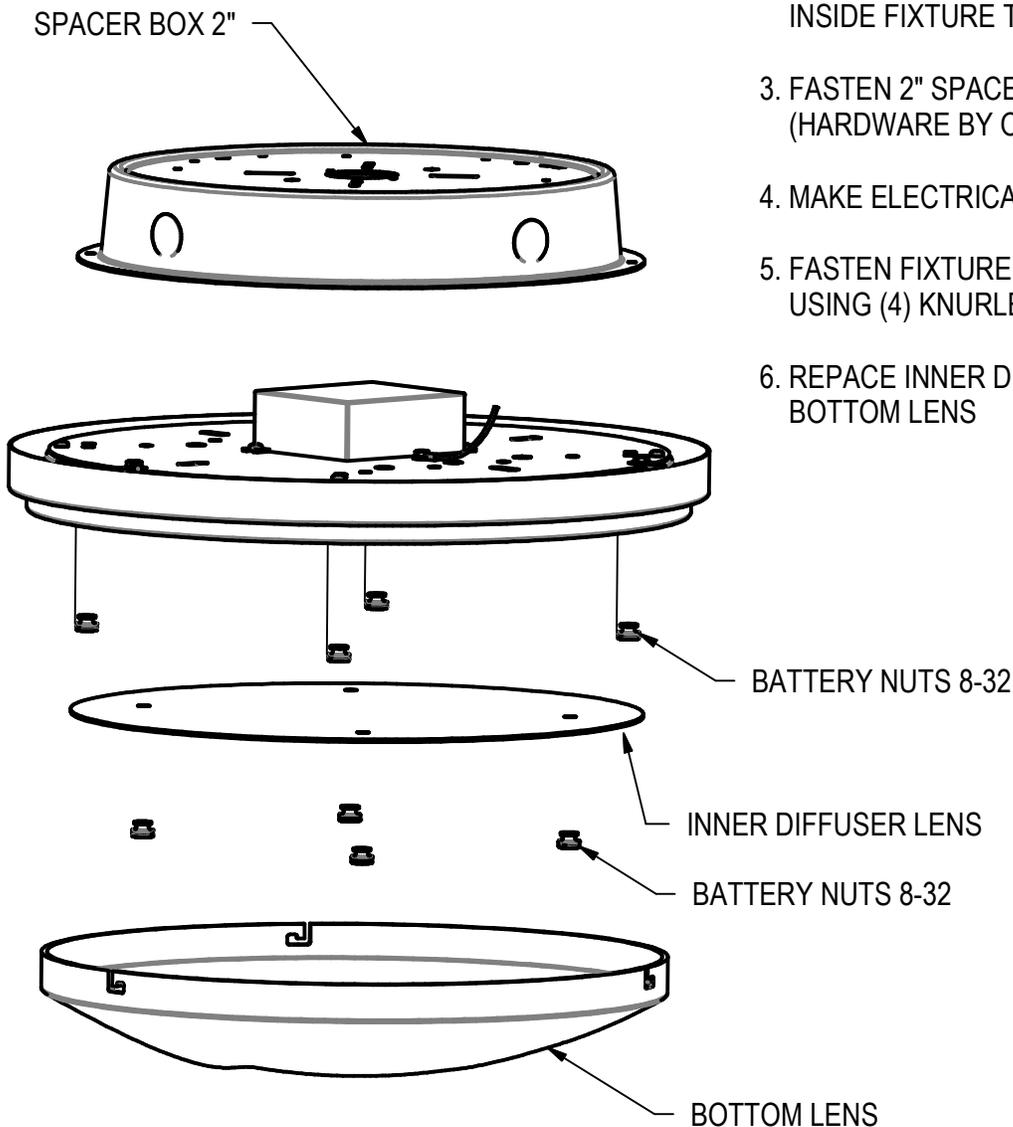

4/4/2016
IS95019X