

IMPORTANT SAFETY AND INSTALLATION INSTRUCTIONS

WARNING: Risk of fire and electrical shock. This product is to be installed by a qualified electrician only.

CAUTION: When using electrical equipment, basic safety precautions should always be followed including the following: Read all instructions carefully before installation and save

for future use. Make sure installation and all connections are in accordance with National Electrical Code and any local regulations. To avoid possible electrical shock, be sure that power supply is turned off before installing or servicing this fixture. Servicing should be performed by qualified service personnel.

These instructions do not claim to cover all details or variations. When additional information is desired, please contact your SPI representative.

REMOTE CLASS II POWER SUPPLY - WIRING INSTRUCTIONS

LED WIRING REQUIREMENTS


CAUTION: FIXTURE MUST BE CONNECTED TO A CLASS 2 POWER UNIT. FAILURE TO USE A CLASS 2 POWER UNIT VOIDS WARRANTY AND UL LISTING.

> LOW VOLTAGE CIRCUITS ARE LIMITED IN DISTANCE BY CURRENT CAPACITY AND VOLTAGE DROPS THROUGH THE CONDUCTORS AND RATINGS OF COMPONENTS IN THE SYSTEM. FOR REMOTE APPLICATIONS OVER 15 FEET CONSULT FACTORY TO CONFIRM DISTANCE AND SYSTEM COMPATIBILITY.

> CONSULT FACTORY FOR LED DIMMING, RGB, DMX INTERFACE AND SPECIAL WIRING CONFIGURATIONS.

> INSTALL AND CONNECT LED POWER SUPPLIES IN ACCORDANCE WITH NEC, ARTICLE 725, AS WELL AS ANY LOCAL REGULATIONS AND CODES.

> SINGLE FIXTURE INSTALL IN MOST COMMON. VERIFY NUMBER OF DRIVERS IN SYSTEM WITH PAIRS OF FIXTURE WIRES BEFORE WIRING USING THE MULTIPLE FIXTURE DIAGRAM.

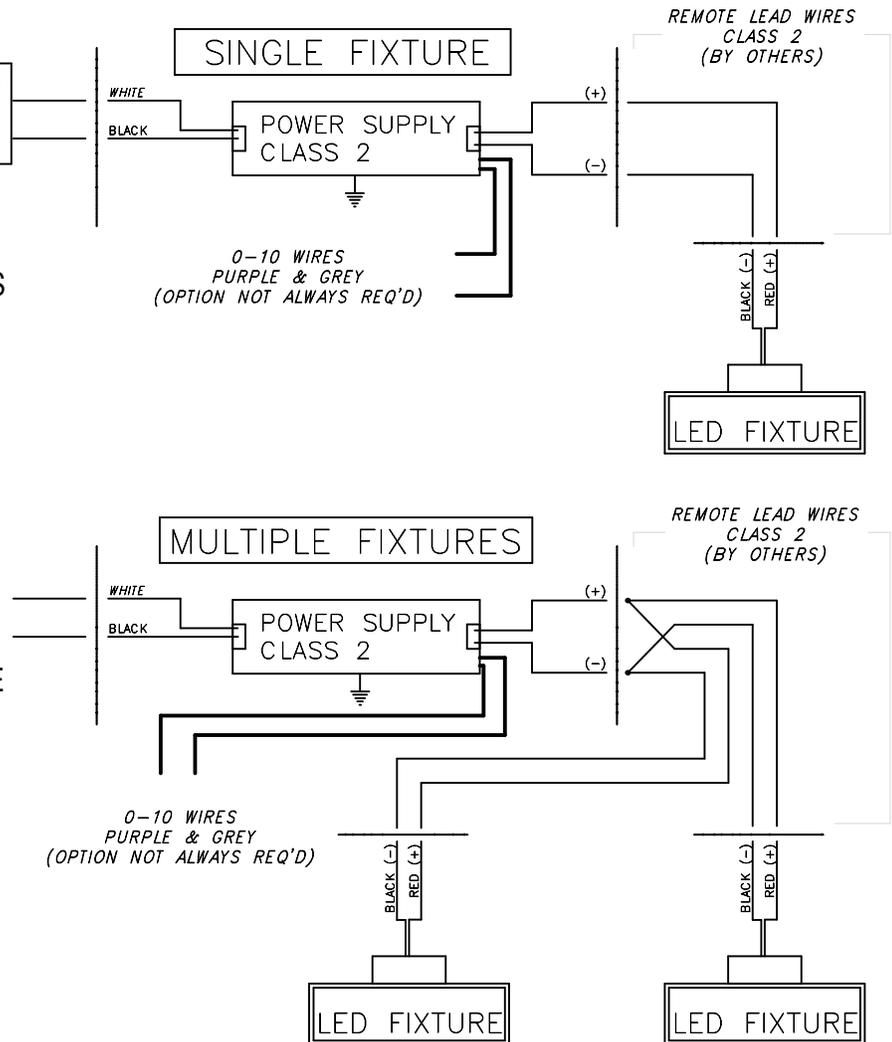

03/18/2019
IS59584X