

IMPORTANT SAFETY AND INSTALLATION INSTRUCTIONS

WARNING: Risk of fire and electrical shock. This product is to be installed by a qualified electrician only.

CAUTION: When using electrical equipment, basic safety precautions should always be followed including the following: Read all instructions carefully before installation and save

for future use. Make sure installation and all connections are in accordance with National Electrical Code and any local regulations. To avoid possible electrical shock, be sure that power supply is turned off before installing or servicing this fixture. Servicing should be performed by qualified service personnel.

These instructions do not claim to cover all details or variations. When additional information is desired, please contact your SPI representative.

LIGHTRUSS SYSTEM - RADIUS SECTION

1. Start installation of radius section by mounting the two adjacent fixture types.

See "Lightruss General Construction" layout for mounting locations.

2. Remove the small, 1.5" long, extrusion covers (4-places.) Remove the mounting hub from the ends of the curved tubes by removing the set screw.

3. Install mounting hubs to end of each extrusion, making sure the tapped hole for the set screw of the hub is on the bottom. The plain through hole is on top.

3. Feed the wire harnesses through the curved tubes that corresponds to the matching wires in the adjacent extrusions. (Chamber 1 harness should align with Chamber 1 wires in extrusion, and so on.)


4. Raise curved tube into position, with holes on top, and feed the ends of the wire harnesses through the mounting hubs. Slide the tube onto the mounting hub and carefully thread the set screw through the top hole, making sure not to pinch any wires. Tighten set screw. Repeat for all mounting hubs.

5. Connect matching colored wires, in matching chambers, between the radius section and the adjacent sections.

BE CAREFUL TO NOT CONNECT SIMILAR COLORED WIRES BETWEEN TWO DIFFERENT EXTRUSION CHAMBERS.

6. Push wire and connectors back into extrusion and curved tube. Replace small extrusion covers.

***Note: Not all radius sections include wire harnesses. Without harnesses, install the same way as above, omitting any instructions regarding the wires.

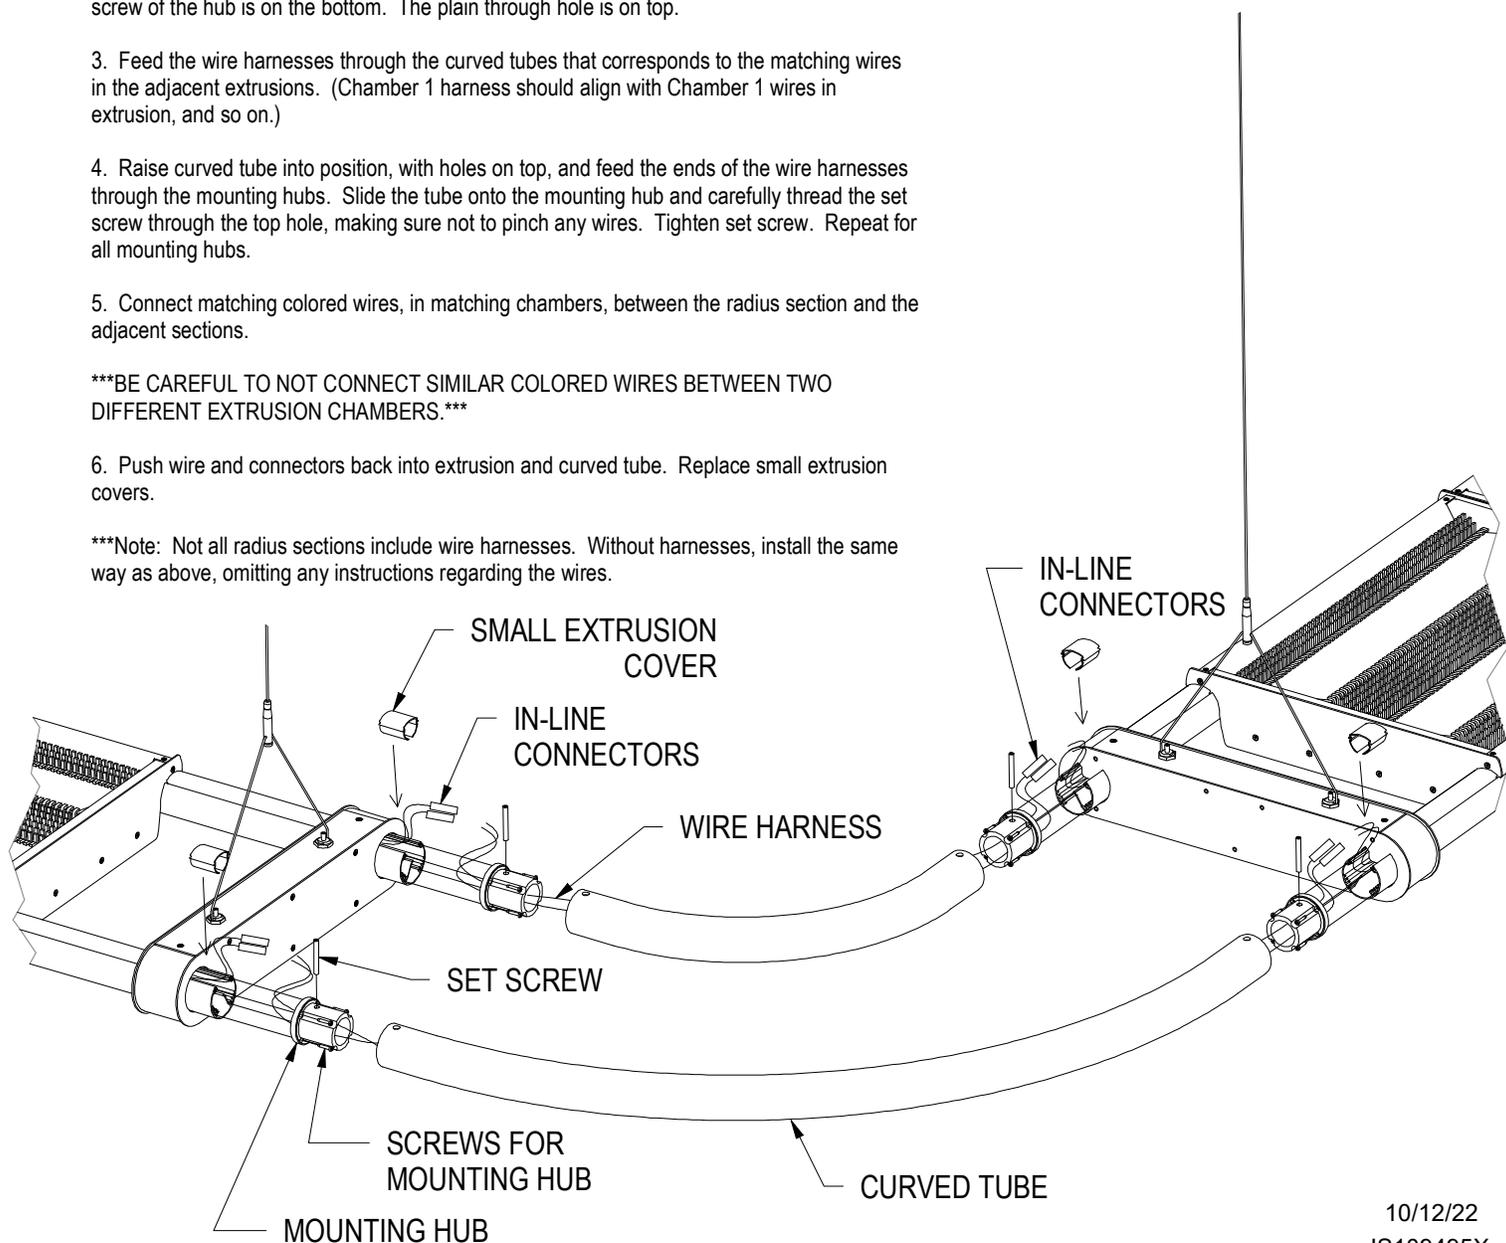

10/12/22
IS109495X